

ACI 314R-16

Guide to Simplified Design for Reinforced Concrete Buildings

(For Buildings of Limited Size and Height,
based on ACI 318-14 and ACI IPS-1, “Essential
Requirements for Reinforced Concrete
Buildings”)

Reported by ACI Committee 314



American Concrete Institute
Always advancing



Guide to Simplified Design for Reinforced Concrete Buildings

Copyright by the American Concrete Institute, Farmington Hills, MI. All rights reserved. This material may not be reproduced or copied, in whole or part, in any printed, mechanical, electronic, film, or other distribution and storage media, without the written consent of ACI.

The technical committees responsible for ACI committee reports and standards strive to avoid ambiguities, omissions, and errors in these documents. In spite of these efforts, the users of ACI documents occasionally find information or requirements that may be subject to more than one interpretation or may be incomplete or incorrect. Users who have suggestions for the improvement of ACI documents are requested to contact ACI via the errata website at <http://concrete.org/Publications/DocumentErrata.aspx>. Proper use of this document includes periodically checking for errata for the most up-to-date revisions.

ACI committee documents are intended for the use of individuals who are competent to evaluate the significance and limitations of its content and recommendations and who will accept responsibility for the application of the material it contains. Individuals who use this publication in any way assume all risk and accept total responsibility for the application and use of this information.

All information in this publication is provided “as is” without warranty of any kind, either express or implied, including but not limited to, the implied warranties of merchantability, fitness for a particular purpose or non-infringement.

ACI and its members disclaim liability for damages of any kind, including any special, indirect, incidental, or consequential damages, including without limitation, lost revenues or lost profits, which may result from the use of this publication.

It is the responsibility of the user of this document to establish health and safety practices appropriate to the specific circumstances involved with its use. ACI does not make any representations with regard to health and safety issues and the use of this document. The user must determine the applicability of all regulatory limitations before applying the document and must comply with all applicable laws and regulations, including but not limited to, United States Occupational Safety and Health Administration (OSHA) health and safety standards.

Participation by governmental representatives in the work of the American Concrete Institute and in the development of Institute standards does not constitute governmental endorsement of ACI or the standards that it develops.

Order information: ACI documents are available in print, by download, on CD-ROM, through electronic subscription, or reprint and may be obtained by contacting ACI.

Most ACI standards and committee reports are gathered together in the annually revised ACI Manual of Concrete Practice (MCP).

American Concrete Institute
38800 Country Club Drive
Farmington Hills, MI 48331
Phone: +1.248.848.3700
Fax: +1.248.848.3701

www.concrete.org

Guide to Simplified Design for Reinforced Concrete Buildings

(For Buildings of Limited Size and Height, based on ACI 318-14 and ACI IPS-1, “Essential Requirements for Reinforced Concrete Buildings”)

Reported by ACI Committee 314

Michael C. Mota, Chair

Esteban Anzola, Secretary

John Aidoo
Iyad M. Alsamsam
JoAnn P. Browning
James R. Cagley
Omar D. Cardona
Julian Carrillo
W. Gene Corley
Om P. Dixit

David A. Fanella
Yosef Farbiarz
Luis E. García
Jose M. Izquierdo-Encarnación
Mahmoud E. Kamara
Jason J. Krohn
James S. Lai
Lionel A. Lemay

Andres Lepage
Adolfo B. Matamoros
Mustafa Mahamid
Lila Gabriela Mendez Florez
Javeed Munshi
T. George Muste
Ronald L. O’Kane
Guney Ozcebe

Viral B. Patel
Santiago Pujol
William E. Rushing Jr.
Guillermo Santana
Jorge I. Segura
Larbi M. Sennour
Dorian P. Tung
Jairo Uribe

Special acknowledgment to J. P. Browning, L. E. García, J. M. Izquierdo-Encarnación, J. S. Lai, M. C. Mota, S. Pujol, and J. I. Segura for their contributions to this guide.

This document is dedicated to the memory of late subcommittee member W. Gene Corley.

This guide presents simplified methods and design techniques that facilitate and speed the engineering of low-rise buildings within certain limitations. Material is presented in an order that follows typical design process with procedures introduced as the designer will need them in the course of a building design. Much of the information presented in this guide is derived from ACI 318, ASCE 7, and the 2015 International Building Code (IBC) (International Code Council 2015). The quality and testing of materials used in construction are covered by references to the appropriate ASTM standard specifications.

Whereas many of the tables, charts, and values included in this guide originated from the aforementioned reference documents, they have been modified or reorganized to be more conservative, to match design process flow, or better support the holistic and simplified design approach presented.

Although this guide is not written in mandatory language, the information is presented in such a manner that a structure designed following this guide will, in principle, comply with the codes and

standards on which it was based. Although this guide is written in nonmandatory language, it is meant to be applied as a whole, because the simplified provisions are interdependent, and it would be unsafe to employ only a portion of this guide and disregard the remainder. This guide is not a code and is not deemed to satisfy ACI 318, ASCE 7, and the International Building Code (International Code Council 2015). This guide is expected to be especially useful in the education and training of engineers in reinforced concrete design of low-rise structures of small to medium floor areas.

There are many options within these standards that are not considered in this guide, such as the use of supplementary cementitious materials in concrete mixtures. As this guide will be used as a design aid, it is the licensed design professional’s responsibility to ensure that the structure design satisfies the requirements of ACI 318, ASCE 7, the International Building Code (International Code Council 2015), and the legal requirements of the local jurisdiction. The original draft of the guide, published as ACI IPS-1 (2002), was produced by a Joint Committee of Instituto Colombiano de Normas Técnicas y Certificación (Colombian Institute for Technical Standards and Certification) (ICONTEC) and Asociación Colombiana de Ingeniería Sísmica (Colombian Association for Earthquake Engineering) (AIS).

The initial drafting of ACI IPS-1 (2002) was motivated by frequent worldwide discussions that reinforced concrete codes might be unnecessarily sophisticated for some applications, such as small low-rise buildings. Current knowledge of reinforced concrete behavior obtained through experimentation and experi-

ACI Committee Reports, Guides, and Commentaries are intended for guidance in planning, designing, executing, and inspecting construction. This document is intended for the use of individuals who are competent to evaluate the significance and limitations of its content and recommendations and who will accept responsibility for the application of the material it contains. The American Concrete Institute disclaims any and all responsibility for the stated principles. The Institute shall not be liable for any loss or damage arising therefrom.

Reference to this document shall not be made in contract documents. If items found in this document are desired by the Architect/Engineer to be a part of the contract documents, they shall be restated in mandatory language for incorporation by the Architect/Engineer.

ACI 314R-16 supersedes ACI 314R-11 and became effective June 2016.

Copyright © 2016, American Concrete Institute.

All rights reserved including rights of reproduction and use in any form or by any means, including the making of copies by any photo process, or by electronic or mechanical device, printed, written, or oral, or recording for sound or visual reproduction or for use in any knowledge or retrieval system or device, unless permission in writing is obtained from the copyright proprietors.

ence, and its status and dissemination as a structural material used worldwide, made developing a simplified design and construction guide feasible. This guide used *ACI IPS-1 (2002)* as a basis, with information derived from *ACI 318*, *ASCE 7*, and the *International Building Code (International Code Council 2015)*.

This guide presents simplified approaches to assist engineers in designing low-rise buildings within certain limitations, in addition to the following:

- (a) Information on the order needed in the course of a design
- (b) Explanatory material at appropriate places
- (c) Computations only requiring a hand calculator
- (d) Graphs and graphical explanations
- (e) Design information based on simplified strength models
- (f) Other limit states accounted for by minimum dimensions
- (g) Conservative loads and simplified analysis guidelines
- (h) Simplified geotechnical information to help define soil-bearing capacity
- (i) Shear walls as the seismic-force-resisting system
- (j) Material and construction guidelines based on commonly available steel grades and medium-strength concrete that can be site mixed.

Keywords: concrete quality; foundation design; frame analysis; inspection; low-rise building construction; low-rise structure; mixing; placing; section analysis; seismic design; simplified design; specifications; structure design; structure layout.

CONTENTS

CHAPTER 1—GENERAL, p. 3

- 1.1—Scope, p. 3
- 1.2—Purpose, p. 3
- 1.3—Limitations, p. 3
- 1.4—Supporting codes and standards, p. 4
- 1.5—Design and construction procedure, p. 5
- 1.6—Limit states, p. 6
- 1.7—Strength design, p. 6
- 1.8—Serviceability design, p. 7

CHAPTER 2—NOTATION AND DEFINITIONS, p. 7

- 2.1—Notation, p. 7
- 2.2—Definitions, p. 10

CHAPTER 3—STRUCTURAL SYSTEM LAYOUT, p. 14

- 3.1—Description of structural components, p. 14
- 3.2—General, p. 15
- 3.3—Structural layout, p. 15
- 3.4—Feasibility of guide usage, p. 16

CHAPTER 4—LOADS, p. 16

- 4.1—General, p. 16
- 4.2—Load factors and load combinations, p. 16
- 4.3—Mass and weight, p. 17
- 4.4—Weight of materials, p. 17
- 4.5—Dead loads, p. 17
- 4.6—Live loads, p. 21
- 4.8—Rain load, p. 22
- 4.9—Snow load, p. 22
- 4.10—Wind loads, p. 22
- 4.12—Soil weight and lateral pressure, p. 26

- 4.13—Lateral loads, p. 26
- 4.14—Lateral-force-resisting system, p. 27
- 4.15—Minimum amount of reinforced concrete structural walls, p. 29

CHAPTER 5—GENERAL REINFORCED CONCRETE INFORMATION, p. 31

- 5.1—Scope, p. 31
- 5.2—Materials for reinforced concrete, p. 31
- 5.3—Minimum and maximum reinforcing bar diameter, p. 31
- 5.5—Minimum reinforcement bend diameter, p. 32
- 5.8—Development length, lap splicing, and anchorage of reinforcement, p. 34
- 5.9—Longitudinal reinforcement, p. 34
- 5.10—Transverse reinforcement, p. 35
- 5.11—Flexure, p. 35
- 5.12—Axial loads with or without flexure, p. 36
- 5.13—Shear, p. 37
- 5.14—Bearing, p. 39

CHAPTER 6—FLOOR SYSTEMS, p. 39

- 6.1—Types of floor systems, p. 39
- 6.2—Selection of floor system, p. 42
- 6.3—Structural integrity, p. 42
- 6.4—One-way and two-way load paths, p. 42
- 6.5—Minimum depth for floor system members, p. 42
- 6.6—Triangular dimensions for floor system, p. 44
- 6.7—Floor finish, p. 44
- 6.8—Ducts, shafts, openings, and embedded piping, p. 44

CHAPTER 7—SOLID SLABS SUPPORTED ON GIRDERS, BEAMS, JOISTS, OR REINFORCED CONCRETE WALLS, p. 45

- 7.1—General, p. 45
- 7.2—Loads, p. 45
- 7.3—Reinforcement details, p. 45
- 7.4—Shear strength, p. 47
- 7.5—Slab between joists, p. 47
- 7.6—Cantilevers of slabs supported on girders, beams, or walls, p. 48
- 7.7—One-way, single-span solid slabs spanning between girders, beams, or reinforced concrete walls, p. 49
- 7.8—One-way solid slabs supported on girders, beams, or walls with two or more spans, p. 50
- 7.9—Two-way solid slabs spanning between girders, beams, or reinforced concrete walls, p. 51

CHAPTER 8—GIRDERS, BEAMS, AND JOISTS, p. 59

- 8.1—General, p. 59
- 8.2—Loads, p. 59
- 8.3—Reinforcement types, p. 59
- 8.4—Longitudinal reinforcement, p. 60
- 8.5—Transverse reinforcement, p. 64
- 8.6—Joists and beams supported by girders, p. 66
- 8.7—Girders that are part of a frame, p. 70

CHAPTER 9—SLAB-COLUMN SYSTEMS, p. 72

- 9.1—General, p. 72
- 9.2—Loads, p. 72
- 9.3—Dimensional limits, p. 73
- 9.4—Reinforcement details, p. 74
- 9.5—Shear strength, p. 76
- 9.6—Minimum slab thickness as required by punching shear, p. 77
- 9.7—Minimum slab thickness as required by beam action, p. 77
- 9.8—Flexure, p. 78
- 9.9—Calculation of support reactions, p. 80

CHAPTER 10—COLUMNS, p. 80

- 10.1—General, p. 80
- 10.2—Loads, p. 80
- 10.3—Dimensional limits, p. 81
- 10.4—Reinforcement details, p. 82
- 10.5—Flexure, p. 86
- 10.6—Shear, p. 86
- 10.7—Calculation of foundation reaction, p. 87

CHAPTER 11—SEISMIC RESISTANCE, p. 87

- 11.1—Special reinforcement details for seismic zones, p. 87
- 11.2—Interaction with nonstructural elements, p. 93

CHAPTER 12—REINFORCED CONCRETE WALLS, p. 94

- 12.1—General, p. 94
- 12.2—Loads, p. 94
- 12.3—Dimensional limits, p. 95
- 12.4—Reinforcement details, p. 95
- 12.5—Flexure, p. 97
- 12.6—Shear, p. 97
- 12.7—Calculation of reactions at the foundation, p. 97
- 12.8—Core walls, p. 98

CHAPTER 13—OTHER STRUCTURAL MEMBERS, p. 98

- 13.1—Stairways and ramps, p. 98
- 13.2—Small water tanks (for potable water storage), p. 100

CHAPTER 14—FOUNDATIONS, p. 101

- 14.1—Soil investigation, p. 101
- 14.2—Allowable soil-bearing capacity, p. 101
- 14.3—Settlement criteria, p. 102
- 14.4—Dimensioning foundation members, p. 102
- 14.5—Spread footings, p. 102
- 14.6—Wall footings, p. 106
- 14.7—Combined footings, p. 107
- 14.8—Piles and caissons, p. 108
- 14.9—Footings on piles, p. 108
- 14.10—Foundation mats, p. 108
- 14.11—Retaining walls, p. 110
- 14.12—Grade beams (foundation beams), p. 114
- 14.13—Slabs-on-ground, p. 115

CHAPTER 15—DRAWINGS AND SPECIFICATIONS, p. 115

- 15.1—General, p. 115
- 15.2—Structural drawings, p. 116
- 15.3—Project specifications, p. 117

CHAPTER 16—CONSTRUCTION, p. 117

- 16.1—Introduction, p. 117
- 16.2—Concrete mixture proportioning, p. 118
- 16.4—Concrete mixing and transportation, p. 120
- 16.5—Concrete strength evaluation, p. 122
- 16.6—Concrete curing, p. 123
- 16.7—Form removal, p. 123

CHAPTER 17—REFERENCES, p. 124**APPENDIX A—COMPARISON OF ACI 314R-16 TO ACI 318-14, INTERNATIONAL BUILDING CODE (2015), AND ASCE 7-10, p. 125****CHAPTER 1—GENERAL****1.1—Scope**

This guide is intended for the planning, design, and construction of reinforced concrete structures in new low-rise buildings of restricted occupancy, number of stories, and area. Although the information presented was developed to produce, when properly used, a reinforced concrete structure with an appropriate margin of safety, this guide is not a replacement for a licensed design professional's experience and working knowledge. For the structure designed by this guide to attain the intended margin of safety, the guide should be used as a whole, and alternative procedures should be used only when explicitly permitted herein. The minimum dimensioning prescribed in the guide replace, in most cases, more detailed procedures prescribed in **ACI 318**, **ASCE 7**, and the International Building Code (**International Code Council 2015**).

1.2—Purpose

This guide provides a licensed design professional with sufficient information to design structural reinforced concrete members that comprise the structural framing of a low-rise building with the limits set in 1.3. Design rules set forth in this guide are simplifications that, when used together, comply with the more detailed requirements of **ACI 318**, **ASCE 7**, and the International Building Code (**International Code Council 2015**).

1.3—Limitations

This guide is only meant for buildings meeting all the limitations set forth in 1.3.1 to 1.3.10. These limits maintain the guide scope in close adherence to the collective experience of the original drafting committee (**ICONTEC-AIS**). Buildings within this scope are expected to have a normal rectangular footprint with simple standard geometries and member dimensions in both plan and vertical directions. Such buildings also depend primarily on reinforced concrete

Table 1.3.1.1—Permitted uses and occupancies

Occupancy group	Occupancy subgroup		Permitted
Group A—Assembly	A-1	Fixed-seating theaters, television, and radio studios	NO
	A-2	Building having an assembly room with capacity less than 100 persons and not having a stage	YES
	A-3		
	A-4	Arenas, skating rinks, swimming pools, and tennis courts	NO
	A-5	Amusement parks, bleachers, grandstands, and stadiums	NO
Group B—Business	B	Building for use as offices, or professional services containing eating and drinking establishments with less than 50 occupants	YES
Group E—Educational	E	Educational purposes with less than 500 students and staff	YES
Group F—Factory	F-1	Light industries not using heavy machinery	YES
	F-2	Heavy industries using heavy machinery	NO
Group H—Hazardous	H	Manufacturing, processing, generation, or storage of materials that constitute a physical or health hazard	NO
Group I—Institutional	I-1	Residential board and care facilities	YES
	I-2	Hospitals	NO
	I-3	Prisons, jails, reformatories, and detention centers	YES
	I-4	Daycare facilities	YES
Group M—Mercantile	M	Display and sale of merchandise	YES
Group R—Residential	R-1	Hotels having an assembly room with capacity less than 100 persons and not having a stage	YES
	R-2	Apartment buildings and dormitories	YES
	R-3	Houses	YES
	R-4	Residential care and assisted-living facilities	YES
Group S—Storage	S-1	Storage of heavy or hazardous materials	NO
	S-2	Storage of light materials	YES
Group U—Utility and miscellaneous	U	Utilities, water supply systems, and power-generating plants	NO
	U	Garages for vehicles with carrying capacity up to 4000 lb (1800 kg)	YES
	U	Garages for trucks of more than 4000 lb (1800 kg) carrying capacity	NO

structural walls for lateral load resistance. Observing these limits justifies the simplified analysis and design methods herein without the need for special analyses, including slenderness and second-order effects. Buildings with offsets, reentrant corners, and vertical or horizontal irregularities are outside the scope of this guide.

1.3.1 Use and occupancy

1.3.1.1 Permitted uses and occupancies—Table 1.3.1.1 lists building occupancy groups and subgroups, indicating for each whether the use of this guide is permitted.

1.3.1.2 Mixed occupancy—Recommendations described in this guide apply to cases involving only combinations for which the use of this guide is permitted, as identified in Table 1.3.1.1.

1.3.2 Maximum number of stories—Recommendations described in this guide apply to buildings with five or fewer stories above ground and no more than one basement level.

1.3.3 Maximum area per floor—The area per floor should not exceed 10,000 ft² (1000 m²).

1.3.4 Maximum story height—Story height, measured from floor finish to floor finish, should not exceed 13 ft (4 m).

1.3.5 Maximum span length—The span length for girders, beams, and slab-column systems, measured center-to-center of the supports, should not exceed 30 ft (10 m).

1.3.6 Maximum difference in span length—Spans should be approximately equal, and the shorter of two adjacent spans should be at least 80 percent of the larger span, except in elevator and stair cores. Refer to 7.9.1 for cores.

1.3.7 Minimum number of spans—There should be at least two spans in each of the two principal directions of the building in plan. Single spans may be permitted in one- and two-story buildings if the span length does not exceed 15 ft (5 m).

1.3.8 Maximum overhang—For girders, beams, and slabs with overhangs, the length of the overhang should not exceed one-third of the length of the first interior span of the member.

1.3.9 Maximum slope for slabs, girders, beams, and joists—When sloping slabs, girders, beams, or joists are used, the slope of the member should not exceed 15 degrees.

1.3.10 Maximum slope of the terrain—The slope of the terrain surrounding the building should not exceed 30 degrees (Fig. 1.3.10) or the ratio of the height of the first story to the smaller dimension of the building in plan.

1.4—Supporting codes and standards

For cases within the limits described in 1.3, this guide is intended to be a simplification complying with the following supporting codes and standards:

- a) **ACI 318**

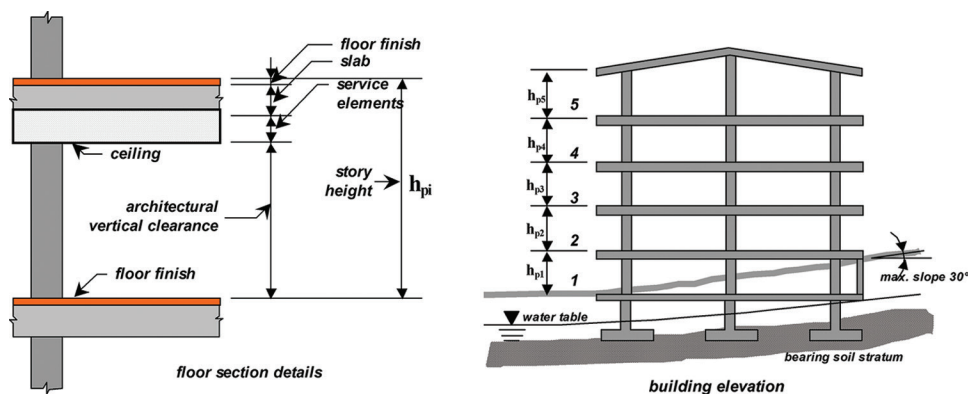


Fig. 1.3.10—General structural layout in elevation.

Table 1.5.1—Design and construction procedure steps

Step	Description	Related chapter(s)
A	Verification that the limitations for using the guide are met. Definition of the layout in plan and height of the structure.	1 and 3
B	Calculation of all gravity loads that act on the structure, excluding the self-weight of the structural members.	4
C	Definition of an appropriate floor system, depending on the span lengths and the magnitude of the gravity loads.	6
D	Selection of trial dimensions for the slab of the floor system. Calculation of the self-weight of the system and design of the members that comprise it, correcting the dimension if needed by the strength and serviceability limit states, complying with the limits for slab systems with beams, or slab-column systems.	6, 7, and 9
E	Trial dimensions for the beams and girders (if needed). Calculation of the self-weight of girders, beams, and joists. Flexural and shear design of the beams and girders, correcting the dimensions if needed by the strength and serviceability limit states.	6 and 8
F	Trial dimensions for the columns. Verification of column slenderness through the use of minimum dimensions. Calculation of the self-weight of the columns. Design of the columns for combination of axial load, moment, and shear. Correcting the dimensions if needed by the strength and serviceability limit states.	10
G	If lateral load, such as earthquake, wind, or lateral earth pressure, is beyond nominal, magnitude and application point are to be established; otherwise the designer may proceed to Step I.	4
H	Preliminary location and trial dimensions for reinforced concrete walls capable of resisting lateral loads. For earthquake loads, the influence of wall self-weight is evaluated. Flexure and shear design of the reinforced concrete walls.	11 and 12
I	Design of the stairways, ramps, small potable water tanks, and retaining walls.	13
J	Loads at the foundation level are determined. Definition of the foundation system is performed. Design of the structural members of the foundation.	14
K	Production of the structural drawings and specifications.	15
L	The structure is built complying with the construction and inspection requirements.	16

b) **ASCE 7**

c) International Building Code (**International Code Council 2015**)

Other cases are not covered by this guide. Please refer to Table A.1 in **Appendix A** for a guide by section to corresponding topics in the supporting codes and standards.

1.5—Design and construction procedure

1.5.1 Procedure—The design procedure comprises the steps listed in Table 1.5.1. Refer also to Fig. 1.5.1a and 1.5.1b. Note that by conforming to the dimensional limits and cover of this guide, a 1-hour fire rating is achieved. This rating is usually sufficient for the permitted occupancies in this guide. Other fire

ratings are beyond the scope of this guide, and such designs should be performed using **ACI 318**, **ASCE 7**, and the International Building Code (International Code Council 2015).

1.5.2 Design documentation—The design steps should be recorded as follows.

1.5.2.1 Calculation record—The licensed design professional should document all design steps in a calculation record. This record should contain, at a minimum, the following:

- General structural program, as defined in **Chapter 3**
- Description of the structural system
- Loads
- Characteristics, strength, and fabrication standards for all structural materials

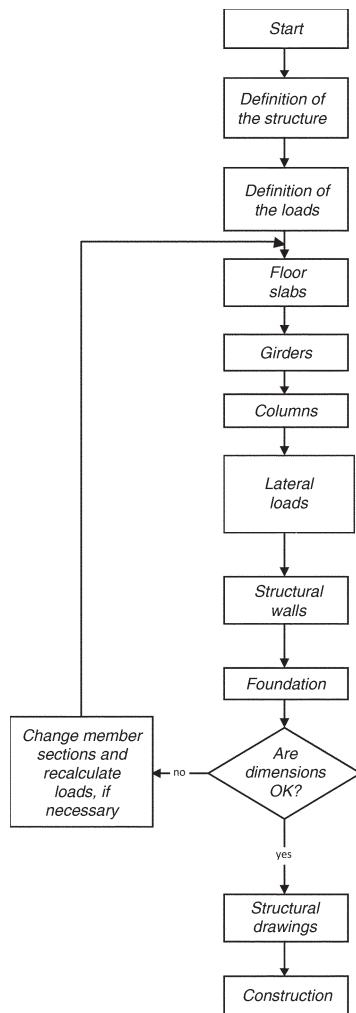


Fig. 1.5.1a—Design and construction procedure.

- (e) Justification of all design calculation
 (f) Sketches of the reinforcement layout for all structural members

1.5.2.2 Geotechnical report—The geotechnical report should record, at a minimum, the soil investigation performed, selected allowable bearing capacity of the soil, soil profile type, lateral soil pressures anticipated for design of any soil-retaining structures, and all other information indicated in **Chapters 4 and 14**.

1.5.2.3 Structural drawings—Structural drawings should include, at a minimum, all the plans indicated by Chapter 15 for construction of the building.

1.5.2.4 Project specifications—Project specifications should include, at a minimum, all the construction specifications described in **Chapter 15**.

1.5.3 Precast concrete components—Precast concrete components may be used, including prestressed concrete manufactured in offsite facilities. Such components should be designed by a licensed design professional in accordance with **ACI 318, ASCE 7**, and the International Building Code (**International Code Council 2015**). Calculations should be reviewed by the licensed design professional of record (1.2) and included in the calculation record (1.5.2.1). Detailing and placing drawings conforming to **15.2.2** should be

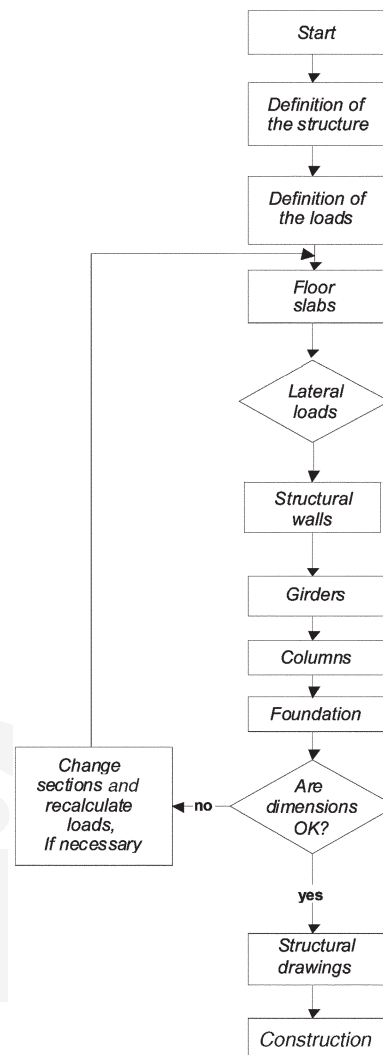


Fig. 1.5.1b—Design and construction procedure for earthquake regions.

furnished and included as part of the structural drawings (1.5.2.3). Manufacture of precast components should be done in a facility with demonstrated capability of producing quality products.

1.6—Limit states

The design approach of this guide is based on limit states, where a limit state is a condition beyond which a structure or member becomes unfit for service and is judged to be unsafe or no longer useful for its intended function. The designer should verify that the strength and serviceability limit states are accounted for in the resulting structure. The following are considered implicitly in the design procedure:

- Structural integrity
- Lateral load story drift
- Durability
- Fire resistance

1.7—Strength design

1.7.1 General—In strength design, the structure and the structural members are dimensioned to have design strengths

at all sections at least equal to the demands calculated for the combinations of factored loads described in Chapter 4.

The basic expression for the strength limit state is

$$\text{resistances} \geq \text{load effects} \quad (1.7.1a)$$

Because resistances may be less than computed and the load effects could be larger than computed, strength reduction factors ϕ less than 1, and load factors γ generally greater than 1, are used

$$\phi R_n \geq \gamma_1 S_1 + \gamma_2 S_2 + \dots \quad (1.7.1b)$$

where R_n is nominal strength, and S is load effects based on the loads described in Chapter 4. Therefore, the strength design requires that

$$\text{design strength} \geq \text{required strength} \quad (1.7.1c)$$

$$\phi (\text{nominal strength}) \geq U \quad (1.7.1d)$$

where the required strength is $U = \gamma_1 S_1 + \gamma_2 S_2 + \dots$

1.7.2 Required strength—The required strength U should be computed for the combinations of factored loads listed in 4.2.

1.7.3 Design strength—The design strength provided by a member, its connections to other members, and its cross sections in terms of flexure, axial load, and shear, is the nominal strength multiplied by a strength reduction factor ϕ . Nominal strength should be calculated for each particular force effect in each of the member types at the defined critical sections. The following strength reduction factors ϕ should be used:

- a) Flexure, without axial load: $\phi = 0.90$
- b) Axial tension and axial tension with flexure: $\phi = 0.90$
- c) Axial compression and axial compression with flexure:
 - i. Columns with ties and reinforced concrete walls: $\phi = 0.65$
 - ii. Columns with spiral reinforcement: $\phi = 0.75$
- d) Shear and torsion: $\phi = 0.75$
- e) Bearing of concrete: $\phi = 0.65$

1.8—Serviceability design

To ensure adequate response during service, follow the recommendations in this guide for limiting dimensions, cover, detailing, and construction. These serviceability conditions include effects such as:

- (a) Long-term environmental effects, including exposure to aggressive environment or corrosion of the reinforcement
- (b) Dimensional changes due to variations in temperature, relative humidity, and other effects
- (c) Excessive cracking of the concrete
- (d) Excessive vertical deflections
- (e) Excessive vibration

CHAPTER 2—NOTATION AND DEFINITIONS

2.1—Notation

A_a = effective seismic peak ground horizontal acceleration in rock for short periods of vibration, expressed as a fraction of gravity g

A_b	=	area of an individual reinforcing bar or wire, in. ² (mm ²)
A_{cb}	=	bearing area of concrete, in. ² (mm ²)
A_{cs}	=	area of core of spirally reinforced compression member measured to outside diameter of spiral, in. ² (mm ²)
A_f	=	contact area of footing with soil, ft ² (m ²)
A_g	=	gross area of section, or area of concrete only excluding area of voids, in. ² (mm ²)
A_i	=	area of additional hanger reinforcement where beams are supported by girders or other beams, in. ² (mm ²)
A_j	=	effective cross-sectional shear area within a joint, in. ² (mm ²)
A_p	=	component, or cladding, wind-exposed surface area, ft ² (m ²)
A_s	=	area of longitudinal tension reinforcement, in. ² (mm ²)
A'_s	=	area of longitudinal compression reinforcement, in. ² (mm ²)
A_{se}	=	steel area at the extreme face of column or reinforced concrete wall, in. ² (mm ²)
$A_{s,min}$	=	minimum area of longitudinal tension reinforcement, in. ² (mm ²)
A_{ss}	=	steel area at the side face of column or reinforced concrete wall, in. ² (mm ²)
A_{st}	=	total area of longitudinal reinforcement, in. ² (mm ²)
A_{su}	=	wind-exposed surface area, ft ² (m ²)
A_v	=	area of shear reinforcement, in. ² (mm ²)
a	=	depth of equivalent rectangular compressive stress block, in. (mm)
a_w	=	distance from edge of wall footing to the resultant of soil reaction in wall footing, in. (mm)
B_f	=	short horizontal dimension of footing, in. (mm)
b	=	width of compression flange of member, or width of member, in. (mm)
b_c	=	width of column section, and for punching shear evaluation, the smallest plan dimension of pedestal, column capital, or drop panel, or thickness change in stepped footings, in. (mm)
b_f	=	width of compression face of member, in. (mm)
b_o	=	perimeter of critical section for two-way shear (punching shear) in slabs, in. (mm)
b_w	=	web width of section, or wall width, in. (mm)
C_p	=	component, or cladding, wind surface pressure coefficient
C_{su}	=	wind surface pressure coefficient
C_{vx}	=	coefficient defined in 4.11.4 for design of seismic loads
c_c	=	least distance from surface of reinforcement to the side face, in. (mm)
D	=	dead loads or related internal moments and loads
d	=	effective depth of section, taken as distance from extreme compression fiber to centroid of tension reinforcement, in. (mm)
d'	=	distance from extreme compression fiber to centroid of compression reinforcement, in. (mm)
d_b	=	nominal diameter of reinforcing bar or wire, in. (mm)
d_c	=	distance from extreme tension fiber to centroid of tension reinforcement, in. (mm)
d_s	=	outside diameter of spiral reinforcement, in. (mm)
E	=	seismic loads or related internal moments and loads