

IN-LB

Inch-Pound Units

An ACI Standard

Qualification of Post-Installed Adhesive Anchors in Concrete (ACI 355.4-19) and Commentary

ACI 355.4-19(21)

Reported by ACI Committee 355



American Concrete Institute
Always advancing



Qualification of Post-Installed Adhesive Anchors in Concrete and Commentary

Copyright by the American Concrete Institute, Farmington Hills, MI. All rights reserved. This material may not be reproduced or copied, in whole or part, in any printed, mechanical, electronic, film, or other distribution and storage media, without the written consent of ACI.

The technical committees responsible for ACI committee reports and standards strive to avoid ambiguities, omissions, and errors in these documents. In spite of these efforts, the users of ACI documents occasionally find information or requirements that may be subject to more than one interpretation or may be incomplete or incorrect. Users who have suggestions for the improvement of ACI documents are requested to contact ACI via the errata website at <http://concrete.org/Publications/DocumentErrata.aspx>. Proper use of this document includes periodically checking for errata for the most up-to-date revisions.

ACI committee documents are intended for the use of individuals who are competent to evaluate the significance and limitations of its content and recommendations and who will accept responsibility for the application of the material it contains. Individuals who use this publication in any way assume all risk and accept total responsibility for the application and use of this information.

All information in this publication is provided "as is" without warranty of any kind, either express or implied, including but not limited to, the implied warranties of merchantability, fitness for a particular purpose or non-infringement.

ACI and its members disclaim liability for damages of any kind, including any special, indirect, incidental, or consequential damages, including without limitation, lost revenues or lost profits, which may result from the use of this publication.

It is the responsibility of the user of this document to establish health and safety practices appropriate to the specific circumstances involved with its use. ACI does not make any representations with regard to health and safety issues and the use of this document. The user must determine the applicability of all regulatory limitations before applying the document and must comply with all applicable laws and regulations, including but not limited to, United States Occupational Safety and Health Administration (OSHA) health and safety standards.

Participation by governmental representatives in the work of the American Concrete Institute and in the development of Institute standards does not constitute governmental endorsement of ACI or the standards that it develops.

Order information: ACI documents are available in print, by download, through electronic subscription, or reprint, and may be obtained by contacting ACI.

ACI codes, specifications, and practices are made available in the ACI Collection of Concrete Codes, Specifications, and Practices. The online subscription to the ACI Collection is always updated, and includes current and historical versions of ACI's codes and specifications (in both inch-pound and SI units) plus new titles as they are published. The ACI Collection is also available as an eight-volume set of books and a USB drive.

American Concrete Institute
38800 Country Club Drive
Farmington Hills, MI 48331
Phone: +1.248.848.3700
Fax: +1.248.848.3701

www.concrete.org

Qualification of Post-Installed Adhesive Anchors in Concrete (ACI 355.4-19) and Commentary

An ACI Standard

Reported by ACI Committee 355

Lee W. Mattis
Chair

Monzer M. Allam

Neal S. Anderson

Jacques A. Bertrand

T. J. Bland

Peter J. Carrato

Harry A. Chambers*

Ronald A. Cook

Rolf Elighausen

Werner A. F. Fuchs

Branko Galunic

Brian C. Gerber

Herman L. Graves

Andra Hoermann-Gast

Brent E. Hungerford

Amy S. Kolczak

Thomas A. Kolden

Anthony J. Lamanna

Nam-Ho Lee

Robert R. McGlohn

Giovanni Muciaccia

Jake Olsen

John E. Pearson

Milton Rodriguez

John F. Silva

Howard Silverman

Patrick J. E. Sullivan

J. Bret Turley

Curtis R. Yojoyama

Jian Zhao

Consulting members

Edwin G. Burdette

Robert W. Cannon

Neil M. Hawkins

Paul R. Hollenbach

Conrad Paulson

Dan R. Stoppenhagen

Harry Wiewel*

*Deceased.

This standard prescribes testing programs and evaluation requirements for post-installed adhesive anchors intended for use in concrete under the design provisions of ACI 318. Testing and assessment criteria are provided for various conditions of use, including seismic loading; sustained loading; aggressive environments; reduced and elevated temperatures; and for determining whether anchors are acceptable for use in uncracked concrete only, or acceptable for service both in cracked and uncracked concrete. Criteria are provided for establishing the characteristic bond strength, reductions for adverse conditions, and the anchor category and associated job-site quality control requirements.

Keywords: adhesive anchors; cracked concrete; fasteners; post-installed anchors; qualification procedures; uncracked concrete.

ACI Committee Reports, Guides, Manuals, and Commentaries are intended for guidance in planning, designing, executing, and inspecting construction. This document is intended for the use of individuals who are competent to evaluate the significance and limitations of its content and recommendations and who will accept responsibility for the application of the material it contains. The American Concrete Institute disclaims any and all responsibility for the stated principles. The Institute shall not be liable for any loss or damage arising therefrom.

Reference to this document shall not be made in contract documents. If items found in this document are desired by the Architect/Engineer to be a part of the contract documents, they shall be restated in mandatory language for incorporation by the Architect/Engineer.

CONTENTS

Chapter 1—Introduction and scope, p. 3

1.1—Introduction

1.2—Scope

1.3—Units of measurement

Chapter 2—Notation and definitions, p. 5

2.1—Notation

2.2—Definitions

Chapter 3—General requirements, p. 12

3.1—Test organization

3.2—Variables and options

3.3—Test requirements

3.4—Assessment for multiple anchor element types for adhesive anchors

3.5—Assessment for alternate drilling methods

ACI 355.4-19 supersedes ACI 355.4-11, was adopted December 2, 2019, and published January 2020.

Copyright © 2020, American Concrete Institute.

All rights reserved including rights of reproduction and use in any form or by any means, including the making of copies by any photo process, or by electronic or mechanical device, printed, written, or oral, or recording for sound or visual reproduction or for use in any knowledge or retrieval system or device, unless permission in writing is obtained from the copyright proprietors.

Chapter 4—Requirements for test specimens, anchor installation, and testing, p. 18

- 4.1—Testing by ITEA and manufacturer
- 4.2—Test samples
- 4.3—Concrete for test members
- 4.4—Requirements for test members
- 4.5—Anchor installation
- 4.6—Drill bit requirements
- 4.7—Test methods
- 4.8—Tests in cracked concrete
- 4.9—Changes to products

Chapter 5—Requirements for anchor identification, p. 25

- 5.1—Basic requirements
- 5.2—Verification
- 5.3—Fingerprinting adhesive materials
- 5.4—Packaging

Chapter 6—Reference tests, p. 25

- 6.1—Purpose
- 6.2—Required tests
- 6.3—Conduct of tests

Chapter 7—Reliability tests, p. 26

- 7.1—Purpose
- 7.2—Required tests
- 7.3—Conduct of tests
- 7.4—Reliability tests
- 7.5—Sensitivity to hole cleaning—dry concrete
- 7.6—Sensitivity to hole cleaning—saturated concrete
- 7.7—Sensitivity to hole cleaning—water-filled hole
- 7.8—Sensitivity to hole cleaning—submerged concrete
- 7.9—Sensitivity to mixing effort
- 7.10—Sensitivity to installation in water-saturated concrete
- 7.11—Sensitivity to installation in water-filled hole—saturated concrete
- 7.12—Sensitivity to installation in submerged concrete
- 7.13—Sensitivity to crack width—low-strength concrete
- 7.14—Sensitivity to crack width—high-strength concrete
- 7.15—Sensitivity to crack width cycling
- 7.16—Sensitivity to freezing and thawing
- 7.17—Sensitivity to sustained loading at standard and maximum long-term temperature
- 7.18—Sensitivity to installation direction
- 7.19—Torque test

Chapter 8—Service-condition tests, p. 33

- 8.1—Purpose
- 8.2—Required tests
- 8.3—Conduct of tests
- 8.4—Tension tests in uncracked and cracked concrete
- 8.5—Tension tests at elevated temperature
- 8.6—Tension tests with decreased installation temperature
- 8.7—Establishment of cure time at standard temperature
- 8.8—Durability assessment
- 8.9—Verification of full concrete capacity in a corner
- 8.10—Determination of minimum spacing and edge distance to preclude splitting

- 8.11—Tests to determine shear capacity of anchor elements with nonuniform cross section
- 8.12—Simulated seismic tension tests
- 8.13—Simulated seismic shear tests

Chapter 9—Supplemental tests, p. 39

- 9.1—Round-robin tests
- 9.2—Tests to determine minimum member thickness

Chapter 10—Assessment of anchors, p. 40

- 10.1—Analysis of data
- 10.2—Normalization of anchor capacities for measured concrete bond and steel strengths
- 10.3—Establishing characteristic values
- 10.4—Assessment of characteristic tension capacity associated with concrete breakout and pullout
- 10.5—Assessment of steel tension capacity
- 10.6—Assessment of steel shear capacity
- 10.7—Assessment of minimum member thickness
- 10.8—Assessment of maximum tightening torque
- 10.9—Assessment of behavior under crack cycling
- 10.10—Assessment of freezing-and-thawing behavior
- 10.11—Assessment of sustained load behavior
- 10.12—Assessment of performance associated with installation direction
- 10.13—Assessment of performance at elevated temperature
- 10.14—Assessment of performance with decreased installation temperature
- 10.15—Assessment for cure time at standard temperature
- 10.16—Assessment of durability requirement
- 10.17—Assessment of performance in corner test
- 10.18—Assessment of performance in minimum spacing and edge distance test
- 10.19—Assessment of performance under seismic tension
- 10.20—Assessment of performance under seismic shear
- 10.21—Establishment of hole cleaning procedures
- 10.22—Establishment of on-site quality control and installation conditions
- 10.23—Assessment based on installation and environmental conditions
- 10.24—Assessment for fire exposure

Chapter 11—Data presentation, p. 52

- 11.1—General requirements
- 11.2—Contents of evaluation report
- 11.3—Data presentation

Chapter 12—Independent testing and evaluation agency requirements, p. 54

- 12.1—General requirements
- 12.2—Certification

Chapter 13—Quality control requirements, p. 55

- 13.1—Quality assurance program
- 13.2—Quality control manuals
- 13.3—Special inspection

Chapter 14—References, p. 55

- 14.1—Referenced standards and reports
- 14.2—Cited references

CHAPTER 1—INTRODUCTION

1.1—Introduction

This standard prescribes testing and evaluation requirements for post-installed adhesive anchor systems intended for use in concrete under the provisions of ACI 318. Criteria are separately prescribed to determine the suitability of adhesive anchors used in uncracked concrete only, or in both cracked and uncracked concrete. Criteria are prescribed to determine the design parameters and performance category for adhesive anchors. Included are assessments of the adhesive anchor system for bond strength, reliability, service conditions, and quality control. Special inspection (13.3) is required during anchor installation as noted in 10.22. Table 1.1 provides an overview of the scope.

R1.1 This standard prescribes the testing programs required to qualify post-installed adhesive anchor systems for design in accordance with ACI 318, Chapter 17. Chapter 17 requires that anchors be tested either for use exclusively in uncracked concrete or for use in cracked and uncracked concrete conditions, whereby it is understood that the presence of cracking may occur at any time over the service life of the anchors. Test and assessment criteria are provided for various conditions, including loads (seismic and sustained), environmental with regard to humidity and temperature, and determination if anchors are acceptable for use in cracked or uncracked concrete. Refer to Cook and Konz (2001) for a review of factors that influence adhesive anchor behavior. Refer to Fuchs et al. (1995) for background on the concrete breakout design model and to Eligehausen et al. (2006) and Zamora et al. (2003) for a discussion of bond models for adhesive and grouted anchors. For a discussion of issues associated with the qualification and design of systems for post-installed reinforcing bars, refer to Spieth et al. (2001).

1.2—Scope

This standard applies only to post-installed adhesive anchors as defined herein.

R1.2 Adhesive anchors resist tension loads with a combination of adhesion and mechanical bond (micro-interlock). Different anchor designs and adhesive types may exhibit a range of performance characteristics. In particular, the sensitivity of adhesive anchors to variations in installation and service-condition parameters (such as hole cleaning, installation orientation, and cracked concrete characteristics) may vary widely from each system. ACI 318 addresses this situation by matching capacity reduction factors to anchor performance categories that are, in turn, established through a series of reliability tests.

1.2.1 This standard applies to anchors with a diameter d_a of 1/4 in. or larger. The drilled hole shall be approximately cylindrical with a diameter $d_o \leq 1.5d_a$. This standard also applies to anchors with an anchor embedment depth h_{ef} not less than four diameters ($4d_a$), or 1-5/8 in., and an embedment depth not exceeding $20d_a$.

R1.2.1 The minimum diameter of 1/4 in. is based on practical considerations regarding the limit of structural anchor applications. The upper limit on the ratio of hole diameter to anchor element diameter provides a demarcation

Table 1.1—Overview of anchor systems

Anchor type	Embedded part	Assessment criteria	
		Uncracked concrete	Table 3.1
Adhesive anchor	Threaded rods, deformed reinforcing bars, or internally threaded steel sleeves with external deformations	Cracked and uncracked concrete	Table 3.2 or Table 3.3

between conditions where a single bond strength can be used to evaluate anchor strength and conditions where bond strengths at both the anchor interface and concrete interface must be determined to evaluate anchor strength. In addition, the value of $1.5d_a$ is based on consideration of typical practice whereby most organic adhesives are used with thin bond lines to limit both adhesive shrinkage and creep of the anchor when under load. The design method deemed to satisfy the anchor design requirements of ACI 318, Chapter 17, is based on an analysis of an anchor database with a maximum diameter of 2 in. While ACI 355.4 gives no limitations on maximum anchor diameter, for anchors beyond this dimension, the testing authority should decide if the tests described in this standard are applicable or if alternative tests and analyses are more appropriate. It may also be desirable to reconsider those tests where only small, medium, and large diameters are tested when the upper diameter is much larger than 1-1/2 in.

A limitation on the minimum embedment length of adhesive anchors is necessary to ensure conformance with the design method deemed to satisfy the anchor design requirements of ACI 318, Chapter 17.

1.2.2 The minimum member thickness shall not be less than the value given by Eq. (10-21). Values of Δh in Eq. (10-21) shall be permitted if they are verified by tests according to Table 3.1, Test no. 14, and Table 3.2, Test no. 20, or Table 3.3, Test no. 15.

1.2.3 This standard does not address the following systems and use conditions:

1. Bulk adhesives mixed in open containers without automatically controlled metering and mixing of adhesive components.
2. Adhesives to adhere structural elements to concrete surfaces outside of a drilled hole.
3. Adhesive anchors in aggressive environments not specifically considered in this standard.
4. Adhesive anchors to resist fatigue or shock loading.
5. Injection-type adhesive anchor systems for horizontal and upwardly inclined installations that do not employ a piston plug or similar device to provide back pressure during the adhesive injection process.

R1.2.3 Correct proportioning (metering) and mixing of adhesive components is critical to their performance. Bulk mixing and delivery of adhesives (for example, those with paddle mixers in buckets), while appropriate for some applications, may not provide anchor performance consistent with the assumptions of this standard. These systems are not considered to provide controlled metering of adhesive components. Bulk dispensing equipment that provides

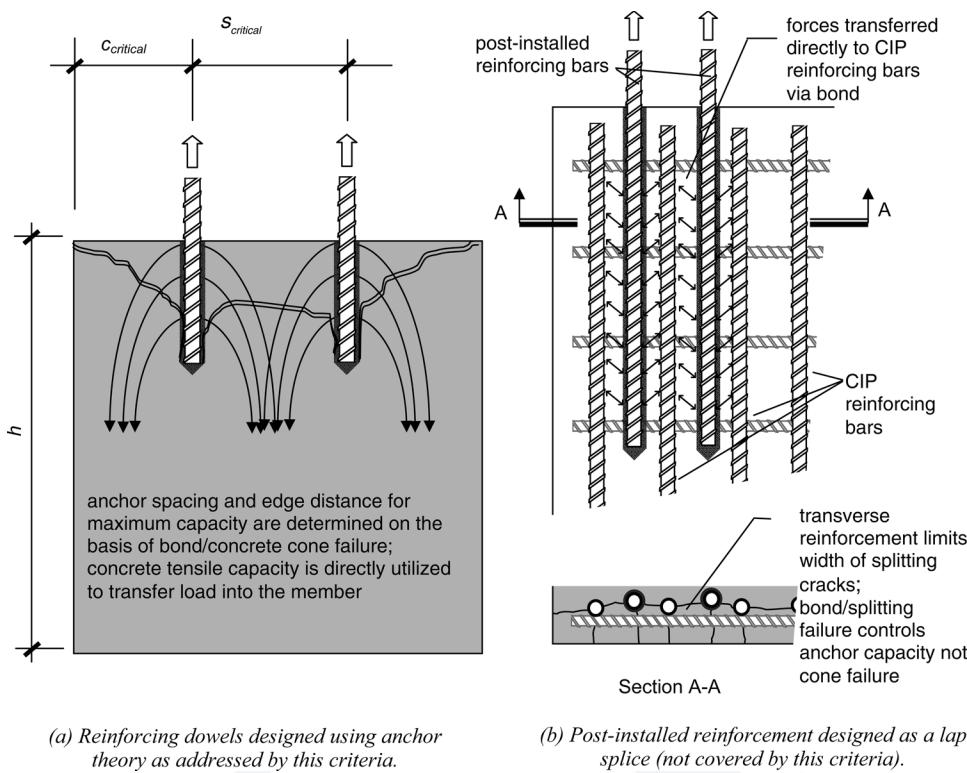


Fig. R1.1—Examples of post-installed reinforcing bars proportioned with anchor theory and with concepts of reinforcement development and splicing.

automatic metering and mixing of the adhesive components is included; however, ongoing monitoring is required to check that the equipment is operating within tolerances in accordance with the Manufacturer's Printed Installation Instructions (MPII), particularly with respect to mixture ratios, leak tightness, and dwell time.

This standard is not appropriate for assessing the use of adhesives to adhere structural elements to the concrete surface. Examples include bonded steel plates or external carbon fiber reinforcement. Other standards exist for these purposes. This standard includes tests to assess the sensitivity of adhesive anchor systems to a limited range of aggressive environments, including moisture, highly alkaline fluids, and sulfur dioxide. While it is believed that these exposure environments envelop a range of possible exposures, specific environments (for example, radiation exposure and chemical production environments) may require unique assessment.

Due to the variety of possible loading conditions associated with fatigue and shock loading, this standard does not include tests for these loading variants. Fatigue and shock loading may result in reductions in bond strength, steel strength, and concrete strength, and these effects are not addressed by this standard. Caution should be exercised in the determination of whether cyclic loading should be explicitly considered. These conditions may be evaluated separately for specific systems using generally accepted principles. Fatigue is generally less of a problem for the adhesive than for the anchor element; provisions of preload in the anchor to reduce the level of stress fluctuation in the

anchor element is only effective if sufficient unbonded length is provided to ensure a reasonable degree of elastic stretch.

Void-free injection of adhesive is critical for the performance of adhesive anchors, particularly for cases involving sustained tension load. This standard includes several criteria for assessing the effectiveness of the adhesive anchor injection system. Nevertheless, the injection of adhesive into horizontal and upwardly inclined holes presents special challenges. The collapse of a tunnel ceiling in Boston, Massachusetts in 2006 highlights this issue. NTSB (2006) documented improper installation of the adhesive based on observation of failed anchors and anchors adjacent to the collapsed section. Subsequent laboratory investigations confirmed these findings, see Ocel and Hartmann (2007). The piston plug was developed to minimize injected air voids (see Fig. 2.2). Laboratory investigations (Silva 2016) indicate that injection of adhesive with only an extension tube, i.e., without the use of a device such as a piston plug to provide back pressure during the injection process, does not result in a sufficient degree of reliability in the installation process. The use of a piston plug during the injection process consistently results in good installation. For small hole diameters (1/4-in. to 3/8-in.), the same effect is accomplished when the extension tube diameter equals the hole diameter.

Consequently, the injection of adhesive in the horizontal or upwardly inclined direction without the use of a piston plug or similar back-pressure device to avoid air voids is no longer included in the scope of this Standard. It is also important to note that the use of the piston plug for proper